


NAME

DATE

ECU 1.0 cm³ PEAK NP cm³ R
GR --- daPa NP daPa

1.5 cm³

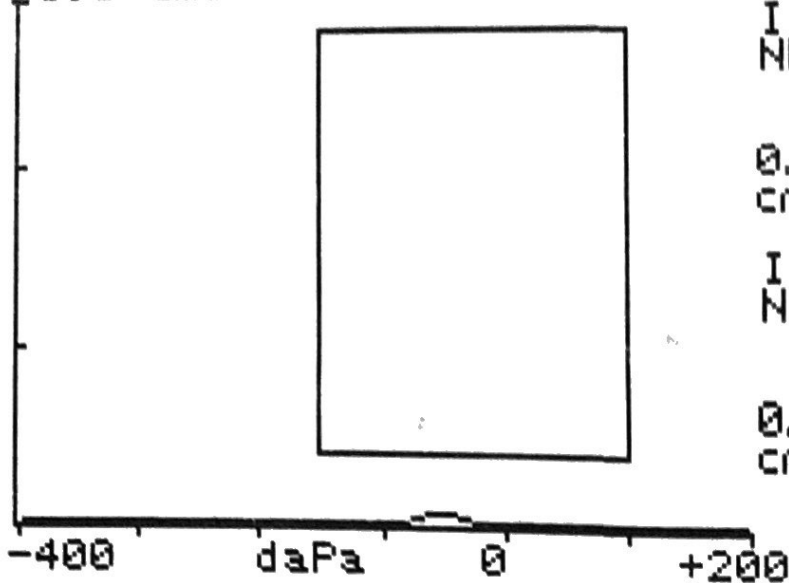

I 500 Hz I 2000 Hz
NR NR

0.1
cm³

I 1000 Hz I 4000 Hz
NR NR


0.1
cm³

0' 0.7 SEC 0' 0.7

??0

ECU 0.9 cm³ PEAK 0.1 cm³ L
GR 30 daPa 180 daPa

1.5 cm³

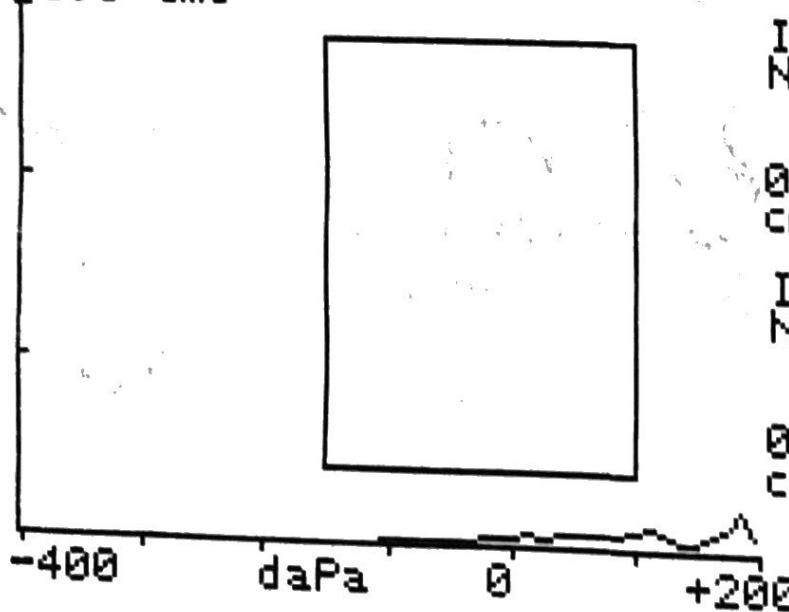

I 500 Hz I 2000 Hz
NR NR

0.1
cm³

I 1000 Hz I 4000 Hz
NR NR

0.1
cm³

0' 0.7 SEC 0' 0.7